



Rating form completed by
Jack Wegleitner, Jay Yin

Text in green is to be part of UC Santa Cruz building database and may be part of UCOP database

DATE: 2019-06-30



6/28/19

UC Santa Cruz building seismic ratings
Social Sciences 1 North

CAAN #7920

Social Sciences 1, Santa Cruz CA 95064

UCSC Campus: Main Campus



Rating summary	Entry	Notes
UC Seismic Performance Level (rating)	V (Poor)	
Rating basis	Tier 1	ASCE 41-17 ¹
Date of rating	2019	
Recommended UC Santa Cruz priority category for retrofit	Priority B	Priority A=Retrofit ASAP Priority B=Retrofit at next permit application
Ballpark total construction cost to retrofit to IV rating ²	Medium (~\$50/sf-\$200/sf)	See recommendations on further evaluation and retrofit.
Is 2018-2019 rating required by UCOP?	Yes	
Further evaluation recommended?	Yes	Focus on brace connections, beams in the chevron braces, and braced frame columns
Also investigate pounding between structures		

¹ We translate this Tier 1 evaluation to a Seismic Performance Level rating using professional judgment. Noncompliant items in the Tier 1 evaluation do not automatically put a building into a particular rating category, but we evaluate such items along with the combination of building features and potential deficiencies, focused on the potential for collapse or serious damage to the gravity supporting structure that may threaten occupant safety. See Section III B of the UC Seismic Policy and Method B of Section 321 of the 2016 California Existing Building Code.

² Per Section 3.A.4.i of the Seismic Program Guidebook, the cost includes all construction cost necessitated by the seismic retrofit, including restoration of finishes and any triggered work on utilities or accessibility. It does not include soft costs such as design fees or campus costs. The cost is in 2019 dollars.

Building information used in this evaluation

- Architectural drawings by Esherick Homsey Dodge and Davis Architects and Planners "College 9 Academic" as-built dated 15 Nov 1991, Sheets A0.1-A9.21.
- Structural drawings by SOH and Associates "College 9 Academic" as-built dated 15 Nov 1991, Sheets S1-S39.
- University of California building database information, "Social Science 1," provided by Jose Sanchez (UCSC) on 2018-11-20.

Additional building information known to exist

None.

Scope for completing this form

Reviewed structural drawings and performed a site visit to confirm as-builts. Evaluated nonstructural life-safety hazards during site visit. Completed an ASCE41-17 Tier 1 evaluation

Brief description of structure

The Social Science 1 building is part of the College Nine campus on UCSC's main campus. The building was designed in 1985 by Esherick Homsey Dodge and Davis Architects and Planners and SOH and Associates. Construction was completed in 1994.

The building site slopes with a partial basement on the down slope side for mechanical rooms. Concrete walls form the basement and act as retaining walls as well as shear walls for the above structure.

The building is divided into two regular braced frame structures separated by a seismic joint. The braced frame extends four stories above the basement and lands on top of the basement walls. The braced frame continues down to shallow foundations along column line 7 which is the furthest down slope.

There is one large lecture hall in the southern portion of the building. A transfer truss supports a column above the lecture hall to avoid landing a column in the middle of the lecture hall. The other spaces in the building are either small classrooms, labs, or office buildings.

The roof on the north structure consists of a mechanical space with less square footage than a typical floor. The mechanical level is supported by a discontinuous braced frame in the north-south direction and a moment frame in the east-west direction.

Identification of levels:

Level 1 is mechanical and electrical rooms. Approximately 75% of the level is unoccupied crawl space due to the sloping site.

Levels 2-5 are occupied offices and classrooms with mechanical equipment on the roof (Floor 1-5, Roof)

Foundation system: The site is sloped and the foundations are at varying levels. The building is on shallow foundations. There are spread footings below columns and strip footings below walls.

Structural system for vertical (gravity) load: The gravity system consists of concrete over metal deck supported on steel beams. Beams are supported by steel columns that frame into walls and footings below. The column base plate is anchored to either the concrete shear wall, concrete column, or spread footing below it.

Structural system for lateral forces: Steel concentric braced frame for four levels over a first level concrete shear walls. The braces are wide flange sections. There are two separate braced frame superstructures with a seismic gap that share a common concrete shear wall basement. There are two frame lines of braces in each direction of each structure. Each frame line has two bays of braces in it.

Brief description of seismic deficiencies and expected seismic performance including mechanism of nonlinear response and structural behavior modes

The columns on the lower floors of the braced frame have a lower strength than required based on the quick checks. The beams in the chevron braces do not have the required strength to resist the combine buckling and yielding demands of the brace pair. The brace to the gusset connection cannot withstand the expected tensile yield force of the brace as required in AISC 341-10. The main deficiencies are the net section and at the welds connecting the gusset to the brace.

Structural deficiency	Affects rating?	Structural deficiency	Affects rating?
Lateral system stress check (wall shear, column shear or flexure, or brace axial as applicable)	Y	Openings at shear walls (concrete or masonry)	N
Load path	N	Liquefaction	N
Adjacent buildings	Y	Slope failure	N
Weak story	N	Surface fault rupture	N
Soft story	N	Masonry or concrete wall anchorage at flexible diaphragm	N
Geometry (vertical irregularities)	N	URM wall height-to-thickness ratio	N
Torsion	N	URM parapets or cornices	N
Mass – vertical irregularity	N	URM chimney	N
Cripple walls	N	Heavy partitions braced by ceilings	N
Wood sills (bolting)	N	Appendages	N
Diaphragm continuity	N		

Summary of review of non-structural life-safety concerns, including at exit routes.³

One exhaust vent up north side of building. Fume hoods in certain lab spaces. Did not have access to all lab spaces in the building to inspect equipment for proper anchorage.

No nonstructural life-safety concerns seen in or around the structure.

UCOP non-structural checklist item	Life safety hazard?	UCOP non-structural checklist item	Life safety hazard?
Heavy ceilings, feature or ornamentation above large lecture halls, auditoriums, lobbies or other areas where large numbers of people congregate	N	Unrestrained hazardous materials storage	N
Heavy masonry or stone veneer above exit ways and public access areas	N	Masonry chimneys	N
Unbraced masonry parapets, cornices or other ornamentation above exit ways and public access areas	N	Unrestrained natural gas-fueled equipment such as water heaters, boilers, emergency generators, etc.	N

³ For these Tier 1 evaluations, we do not visit all spaces of the building; we rely on campus staff to report to us their understanding of if and where nonstructural hazards may occur.

Discussion of rating

The following non-compliance in the Tier 1 checklist form the basis of rating:

1. The columns fail the axial stress quick check on the lower floors
2. The connection strength is not adequate to develop the full yield capacity of the brace where the brace net section is coped at the gusset. The weld of the brace to the gusset also does not have enough capacity to transfer the full yield capacity of the brace.
3. The beams in the chevron brace configuration do not have adequate flexural strength capable of resisting the vertical load due to simultaneous yielding and buckling of the brace pair.

Recommendations for further evaluation or retrofit

A Tier 3 evaluation and a retrofit of the building are recommended based on the deficiencies found.

A retrofit of this building would consist of strengthening the brace framed columns at the lower level and the beams in the chevron braces. The net section of the brace and the brace to gusset weld must be strengthened. Pounding between the two structures should also be investigate further.

Peer review of rating

This seismic evaluation was discussed in a peer review meeting on 28 May 2019. Reviewers present were Bret Lizundia of R+C and Joe Maffei of Maffei Structural Engineers. Comments from the reviewers have been incorporated into this report. The reviewers agreed with the assigned rating.

Additional building data	Entry	Notes
Latitude	37.002390	
Longitude	-122.058126	
Are there other structures besides this one under the same CAAN#	Yes	Social Sciences 1 South. CAAN# 7920.1
Number of stories above lowest perimeter grade	5	
Number of stories (basements) below lowest perimeter grade	0	
Building occupiable area (OGSF)	42,000 sq ft	
Risk Category per 2016 CBC Table 1604.5	II	
Building structural height, h_n	58 ft.	Structural height defined per ASCE 7-16 Section 11.2
Coefficient for period, C_t	0.02	Estimated using ASCE 41-17 equation 4-4 and 7-18
Coefficient for period, β	0.75	Estimated using ASCE 41-17 equation 4-4 and 7-18
Estimated fundamental period	0.42 sec	Estimated using ASCE 41-17 equation 4-4 and 7-18
Site data		
975 yr hazard parameters S_s, S_1	1.291, 0.49	
Site class	D	
Site class basis	Geotech ⁴	See footnote below
Site parameters F_a, F_v	1.2, 1.81	

⁴ Determination of site class and assessment of geotechnical hazards are based on correspondence with Pacific Crest Geotechnical Engineers and Nolan, Zinn, and Associates Geologists. [Revised Geology and Geologic Hazards, Santa Cruz Campus,

Ground motion parameters S_{cs} , S_{c1}	1.55, 1.81	
S_o at building period	1.549	
Site V_{s30}	900 ft/s	
V_{s30} basis	Estimated	Estimated based on site classification D
Liquefaction potential	Low	
Liquefaction assessment basis	County Map	See footnote below
Landslide potential	Low	
Landslide assessment basis	County Map	See footnote below
Active fault-rupture hazard identified at site?	No	
Fault rupture assessment basis	County Map	See footnote below
Site-specific ground motion study?	No	
Applicable code		
Applicable code or approx. date of original construction	Built: 1994 Code: 1985 CBC	
Applicable code for partial retrofit	None	No partial retrofit
Applicable code for full retrofit	None	No full retrofit
Model building data		
Model building type North-South	Steel,S2 - Steel Braced Frames (with Stiff Diaphragm) Concrete,C2 - Concrete Shear Walls (with Stiff Diaphragms) Steel,S1a - Steel Moment Frames (with Flexible Diaphragm)	
Model building type East-West	Steel,S2 - Steel Braced Frames (with Stiff Diaphragm) Concrete,C2 - Concrete Shear Walls (with Stiff Diaphragms) Steel,S1a - Steel Moment Frames (with Flexible Diaphragm)	
FEMA P-154 score	No	Not included here because we performed ASCE 41 Tier 1 evaluation.
Previous ratings		
Most recent rating	Unknown	
Date of most recent rating	Unknown	
2 nd most recent rating	-	
Date of 2 nd most recent rating	-	
3 rd most recent rating	-	
Date of 3 rd most recent rating	-	
Appendices		
ASCE 41 Tier 1 checklist included here?	Yes	Refer to attached checklist file in Appendix A.

University of California, Job # 04003-SC 13 May 2005]. Site class is taken as D throughout the main campus of UC Santa Cruz. The following links provide hazard maps for liquefaction, landslide, and fault rupture:

<https://gis.santacruzcounty.us/mapgallery/Emergency%20Management/Hazard%20Mitigation/LiquifactionMap2009.pdf>
<https://gis.santacruzcounty.us/mapgallery/Emergency%20Management/Hazard%20Mitigation/LandslideMap2009.pdf>
<https://gis.santacruzcounty.us/mapgallery/Emergency%20Management/Hazard%20Mitigation/FaultZoneMap2009.pdf>



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920 - Social Science 1

Appendix A
ASCE 41-17 Checklists

UC Campus:	Santa Cruz			Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers		
Building Name:	Social Sciences 1			Initials:	JSW	Checked:	
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	1	of	3

ASCE 41-17 Collapse Prevention Basic Configuration Checklist

LOW SEISMICITY

BUILDING SYSTEMS - GENERAL

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	LOAD PATH: The structure contains a complete, well-defined load path, including structural elements and connections, that serves to transfer the inertial forces associated with the mass of all elements of the building to the foundation. (Commentary: Sec. A.2.1.1. Tier 2: Sec. 5.4.1.1) Comments:
C NC N/A U <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	ADJACENT BUILDINGS: The clear distance between the building being evaluated and any adjacent building is greater than 0.25% of the height of the shorter building in low seismicity, 0.5% in moderate seismicity, and 1.5% in high seismicity. (Commentary: Sec. A.2.1.2. Tier 2: Sec. 5.4.1.2) Comments: Southern portion of building separated from northern portion by 8 5/8" seismic joint per Arch drawings. Southern portion 55' tall. 1.5% of 55' is 9.75" so NC
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	MEZZANINES: Interior mezzanine levels are braced independently from the main structure or are anchored to the seismic-force-resisting elements of the main structure. (Commentary: Sec. A.2.1.3. Tier 2: Sec. 5.4.1.3) Comments:

BUILDING SYSTEMS - BUILDING CONFIGURATION

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	WEAK STORY: The sum of the shear strengths of the seismic-force-resisting system in any story in each direction is not less than 80% of the strength in the adjacent story above. (Commentary: Sec. A2.2.2. Tier 2: Sec. 5.4.2.1) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	SOFT STORY: The stiffness of the seismic-force-resisting system in any story is not less than 70% of the seismic-force-resisting system stiffness in an adjacent story above or less than 80% of the average seismic-force-resisting system stiffness of the three stories above. (Commentary: Sec. A.2.2.3. Tier 2: Sec. 5.4.2.2) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	VERTICAL IRREGULARITIES: All vertical elements in the seismic-force-resisting system are continuous to the foundation. (Commentary: Sec. A.2.2.4. Tier 2: Sec. 5.4.2.3) Comments:

Note: C = Compliant NC = Noncompliant N/A = Not Applicable U = Unknown

UC Campus:	Santa Cruz			Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers		
Building Name:	Social Sciences 1			Initials:	JSW	Checked:	
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	2	of	3

ASCE 41-17 Collapse Prevention Basic Configuration Checklist

C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>GEOMETRY: There are no changes in the net horizontal dimension of the seismic-force-resisting system of more than 30% in a story relative to adjacent stories, excluding one-story penthouses and mezzanines. (Commentary: Sec. A.2.2.5. Tier 2: Sec. 5.4.2.4)</p> <p>Comments:</p>
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>MASS: There is no change in effective mass of more than 50% from one story to the next. Light roofs, penthouses, and mezzanines need not be considered. (Commentary: Sec. A.2.2.6. Tier 2: Sec. 5.4.2.5)</p> <p>Comments:</p>
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>TORSION: The estimated distance between the story center of mass and the story center of rigidity is less than 20% of the building width in either plan dimension. (Commentary: Sec. A.2.2.7. Tier 2: Sec. 5.4.2.6)</p> <p>Comments: Symmetric towers above the concrete basement level.</p>

MODERATE SEISMICITY (COMPLETE THE FOLLOWING ITEMS IN ADDITION TO THE ITEMS FOR LOW SEISMICITY)

GEOLOGIC SITE HAZARD

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>LIQUEFACTION: Liquefaction-susceptible, saturated, loose granular soils that could jeopardize the building's seismic performance do not exist in the foundation soils at depths within 50 ft (15.2m) under the building. (Commentary: Sec. A.6.1.1. Tier 2: 5.4.3.1)</p> <p>Comments:</p>
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>SLOPE FAILURE: The building site is located away from potential earthquake-induced slope failures or rockfalls so that it is unaffected by such failures or is capable of accommodating any predicted movements without failure. (Commentary: Sec. A.6.1.2. Tier 2: 5.4.3.1)</p> <p>Comments:</p>
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>SURFACE FAULT RUPTURE: Surface fault rupture and surface displacement at the building site are not anticipated. (Commentary: Sec. A.6.1.3. Tier 2: 5.4.3.1)</p> <p>Comments:</p>

Note: C = Compliant NC = Noncompliant N/A = Not Applicable U = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	3	of 3

ASCE 41-17 Collapse Prevention Basic Configuration Checklist

HIGH SEISMICITY (COMPLETE THE FOLLOWING ITEMS IN ADDITION TO THE ITEMS FOR MODERATE SEISMICITY)

FOUNDATION CONFIGURATION

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>OVERTURNING: The ratio of the least horizontal dimension of the seismic-force-resisting system at the foundation level to the building height (base/height) is greater than 0.6S_a. (Commentary: Sec. A.6.2.1. Tier 2: Sec. 5.4.3.3)</p> <p>Comments: 80/58=1.38 0.6*1.549=0.929</p>
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<p>TIES BETWEEN FOUNDATION ELEMENTS: The foundation has ties adequate to resist seismic forces where footings, piles, and piers are not restrained by beams, slabs, or soils classified as Site Class A, B, or C. (Commentary: Sec. A.6.2.2. Tier 2: Sec. 5.4.3.4)</p> <p>Comments: Spread footings restrained by strip footings and walls.</p>

Note: C = Compliant NC = Noncompliant N/A = Not Applicable U = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	1	of 3

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type C2-C2A

Low And Moderate Seismicity

Seismic-Force-Resisting System

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	COMPLETE FRAMES: Steel or concrete frames classified as secondary components form a complete vertical-load-carrying system. (Commentary: Sec. A.3.1.6.1. Tier 2: Sec. 5.5.2.5.1) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	REDUNDANCY: The number of lines of shear walls in each principal direction is greater than or equal to 2. (Commentary: Sec. A.3.2.1.1. Tier 2: Sec. 5.5.1.1) Comments: One shear wall and one braced frame in the longitudinal direction at each foundation level. Two shear walls in the transverse direction.
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	SHEAR STRESS CHECK: The shear stress in the concrete shear walls, calculated using the Quick Check procedure of Section 4.4.3.3, is less than the greater of 100 lb/in. ² (0.69 MPa) or $2\sqrt{f'_c}$. (Commentary: Sec. A.3.2.2.1. Tier 2: Sec. 5.5.3.1.1) Comments: See quick checks
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	REINFORCING STEEL: The ratio of reinforcing steel area to gross concrete area is not less than 0.0012 in the vertical direction and 0.0020 in the horizontal direction. (Commentary: Sec. A.3.2.2.2. Tier 2: Sec. 5.5.3.1.3) Comments: See quick checks

Connections

	Description
C NC N/A U <input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>	WALL ANCHORAGE AT FLEXIBLE DIAPHRAGMS: Exterior concrete or masonry walls that are dependent on flexible diaphragms for lateral support are anchored for out-of-plane forces at each diaphragm level with steel anchors, reinforcing dowels, or straps that are developed into the diaphragm. Connections have strength to resist the connection force calculated in the Quick Check procedure of Section 4.4.3.7. (Commentary: Sec. A.5.1.1. Tier 2: Sec. 5.7.1.1) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	TRANSFER TO SHEAR WALLS: Diaphragms are connected for transfer of seismic forces to the shear walls. (Commentary: Sec. A.5.2.1. Tier 2: Sec. 5.7.2) Comments: Slab reinforcement continued into shear walls or beam parallel to shear wall has shear studs

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	2	of 3

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type C2-C2A

C	NC	N/A	U	FOUNDATION DOWELS: Wall reinforcement is doweled into the foundation with vertical bars equal in size and spacing to the vertical wall reinforcing directly above the foundation. (Commentary: Sec. A.5.3.5. Tier 2: Sec. 5.7.3.4)
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Comments: Indicated in drawings

High Seismicity (Complete The Following Items In Addition To The Items For Low And Moderate Seismicity)

Seismic-Force-Resisting System

				Description
C	NC	N/A	U	DEFLECTION COMPATIBILITY: Secondary components have the shear capacity to develop the flexural strength of the components. (Commentary: Sec. A.3.1.6.2. Tier 2: Sec. 5.5.2.5.2)
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Comments:
C	NC	N/A	U	FLAT SLABS: Flat slabs or plates not part of the seismic-force-resisting system have continuous bottom steel through the column joints. (Commentary: Sec. A.3.1.6.3. Tier 2: Sec. 5.5.2.5.3)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
C	NC	N/A	U	COUPLING BEAMS: The ends of both walls to which the coupling beam is attached are supported at each end to resist vertical loads caused by overturning. (Commentary: Sec. A.3.2.2.3. Tier 2: Sec. 5.5.3.2.1)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments: No coupling beams are present

Diaphragms (Stiff Or Flexible)

				Description
C	NC	N/A	U	DIAPHRAGM CONTINUITY: The diaphragms are not composed of split-level floors and do not have expansion joints. (Commentary: Sec. A.4.1.1. Tier 2: Sec. 5.6.1.1)
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Comments: No split level diaphragms
C	NC	N/A	U	OPENINGS AT SHEAR WALLS: Diaphragm openings immediately adjacent to the shear walls are less than 25% of the wall length. (Commentary: Sec. A.4.1.4. Tier 2: Sec. 5.6.1.3)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:

Flexible Diaphragms

				Description

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	3	of 3

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type C2-C2A

C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	CROSS TIES: There are continuous cross ties between diaphragm chords. (Commentary: Sec. A.4.1.2. Tier 2: Sec. 5.6.1.2)
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	STRAIGHT SHEATHING: All straight-sheathed diaphragms have aspect ratios less than 2-to-1 in the direction being considered. (Commentary: Sec. A.4.2.1. Tier 2: Sec. 5.6.2)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	SPANS: All wood diaphragms with spans greater than 24 ft (7.3 m) consist of wood structural panels or diagonal sheathing. (Commentary: Sec. A.4.2.2. Tier 2: Sec. 5.6.2)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	DIAGONALLY SHEATHED AND UNBLOCKED DIAPHRAGMS: All diagonally sheathed or unblocked wood structural panel diaphragms have horizontal spans less than 40 ft (12.2 m) and aspect ratios less than or equal to 4-to-1. (Commentary: Sec. A.4.2.3. Tier 2: Sec. 5.6.2)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	OTHER DIAPHRAGMS: Diaphragms do not consist of a system other than wood, metal deck, concrete, or horizontal bracing. (Commentary: Sec. A.4.7.1. Tier 2: Sec. 5.6.5)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments:
Connections				
Description				
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	UPLIFT AT PILE CAPS: Pile caps have top reinforcement, and piles are anchored to the pile caps. (Commentary: Sec. A.5.3.8. Tier 2: Sec. 5.7.3.5)
<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments: Spread and strip footings utilized

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	1	of 4

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type S2-S2A

LOW SEISMICITY

SEISMIC-FORCE-RESISTING SYSTEM

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	REDUNDANCY: The number of lines of braced frames in each principal direction is greater than or equal to 2. (Commentary: Sec. A.3.3.1.1. Tier 2: Sec. 5.5.1.1) Comments:
C NC N/A U <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	COLUMN AXIAL STRESS CHECK: The axial stress caused by gravity loads in columns subjected to overturning forces is less than $0.10F_y$. Alternatively, the axial stress caused by overturning forces alone, calculated using the Quick Check procedure of Section 4.4.3.6, is less than $0.30F_y$. (Commentary: Sec. A.3.1.3.2. Tier 2: Sec. 5.5.2.1.3) Comments: See Calcs
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	BRACE AXIAL STRESS CHECK: The axial stress in the diagonals, calculated using the Quick Check procedure of Section 4.4.3.4, is less than $0.50F_y$. (Commentary: Sec. A.3.3.1.2. Tier 2: Sec. 5.5.4.1) Comments:

CONNECTIONS

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	TRANSFER TO STEEL FRAMES: Diaphragms are connected for transfer of seismic forces to the steel frames. (Commentary: Sec. A.5.2.2. Tier 2: Sec. 5.7.2) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	STEEL COLUMNS: The columns in seismic-force-resisting frames are anchored to the building foundation. (Commentary: Sec. A.5.3.1. Tier 2: Sec. 5.7.3.1) Comments:

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	2	of 4

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type S2-S2A

MODERATE SEISMICITY (COMPLETE THE FOLLOWING ITEMS IN ADDITION TO THE ITEMS FOR LOW SEISMICITY)

SEISMIC-FORCE-RESISTING SYSTEM

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	REDUNDANCY: The number of braced bays in each line is greater than 2. (Commentary: Sec. A.3.3.1.1. Tier 2: Sec. 5.5.1.1) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	CONNECTION STRENGTH: All the brace connections develop the buckling capacity of the diagonals. (Commentary: Sec. A.3.3.1.5. Tier 2: Sec. 5.5.4.4) Comments: Existing gusset plate to brace connection geometry is compact, buckling capacity of the diagonals can be developed by inspection.
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	COMPACT MEMBERS: All brace elements meet compact section requirements in accordance with AISC 360, Table B4.1. (Commentary: Sec. A.3.3.1.7. Tier 2: Sec. 5.5.4) Comments:
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	K-BRACING: The bracing system does not include K-braced bays. (Commentary: Sec. A.3.3.2.1. Tier 2: Sec. 5.5.4.6) Comments:

HIGH SEISMICITY (COMPLETE THE FOLLOWING ITEMS IN ADDITION TO THE ITEMS FOR LOW AND MODERATE SEISMICITY)

SEISMIC-FORCE-RESISTING SYSTEM

	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	COLUMN SPLICES: All column splice details located in braced frames develop 50% of the tensile strength of the column. (Commentary: Sec. A.3.3.1.3. Tier 2: Sec. 5.5.4.2) Comments: CJP welds in tension are controlled by the base metal

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	3	of 4

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type S2-S2A

C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	SLENDERNESS OF DIAGONALS: All diagonal elements required to carry compression have Kl/r ratios less than 200. (Commentary: Sec. A.3.3.1.4. Tier 2: Sec. 5.5.4.3) Comments:
C NC N/A U <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	CONNECTION STRENGTH: All the brace connections develop the yield capacity of the diagonals. (Commentary: Sec. A.3.3.1.5. Tier 2: Sec. 5.5.4.4) Comments: DCR of connection for net section rupture and weld strength above 1.0. See calculations
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	COMPACT MEMBERS: All brace elements meet section requirements in accordance with AISC 341, Table D1.1, for moderately ductile members. (Commentary: Sec. A.3.3.1.7. Tier 2: Sec.5.5.4) Comments:
C NC N/A U <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	CHEVRON BRACING: Beams in chevron, or V-braced, bays are capable of resisting the vertical load resulting from the simultaneous yielding and buckling of the brace pairs. (Commentary: Sec. A.3.3.2.3. Tier 2: Sec. 5.5.4.6) Comments: DCR of beam in bending is greater than 1.0. See calculations
C NC N/A U <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	CONCENTRICALLY BRACED FRAME JOINTS: All the diagonal braces frame into the beam–column joints concentrically. (Commentary: Sec. A.3.3.2.4. Tier 2: Sec. 5.5.4.8) Comments: Diagonal Braces on 4th level on line 7/L-M does not frame into a column
DIAPHRAGMS (STIFF OR FLEXIBLE)	
	Description
C NC N/A U <input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	OPENINGS AT FRAMES: Diaphragm openings immediately adjacent to the braced frames extend less than 25% of the frame length. (Commentary: Sec. A.4.1.5. Tier 2: Sec. 5.6.1.3) Comments:
FLEXIBLE DIAPHRAGMS	
	Description
C NC N/A U <input type="checkbox"/> <input type="checkbox"/> <input checked="" type="checkbox"/> <input type="checkbox"/>	CROSS TIES: There are continuous cross ties between diaphragm chords. (Commentary: Sec. A.4.1.2. Tier 2: Sec. 5.6.1.2) Comments:

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown

UC Campus:	Santa Cruz		Date:	6/27/2019		
Building CAAN:	7920	Auxiliary CAAN:	7920.0	By Firm:	Degenkolb Engineers	
Building Name:	Social Sciences 1			Initials:	JSW	Checked:
Building Address:	Social Sciences 1, Santa Cruz, CA 95064			Page:	4	of 4

ASCE 41-17 Collapse Prevention Structural Checklist For Building Type S2-S2A


C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	STRAIGHT SHEATHING: All straight-sheathed diaphragms have aspect ratios less than 2-to-1 in the direction being considered. (Commentary: Sec. A.4.2.1. Tier 2: Sec. 5.6.2)
				Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	SPANS: All wood diaphragms with spans greater than 24 ft (7.3 m) consist of wood structural panels or diagonal sheathing. (Commentary: Sec. A.4.2.2. Tier 2: Sec. 5.6.2)
				Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	DIAGONALLY SHEATHED AND UNBLOCKED DIAPHRAGMS: All diagonally sheathed or unblocked wood structural panel diaphragms have horizontal spans less than 40 ft (12.2 m) and aspect ratios less than or equal to 4-to-1. (Commentary: Sec. A.4.2.3. Tier 2: Sec. 5.6.2)
				Comments:
C <input type="checkbox"/>	NC <input type="checkbox"/>	N/A <input checked="" type="checkbox"/>	U <input type="checkbox"/>	OTHER DIAPHRAGMS: Diaphragms do not consist of a system other than wood, metal deck, concrete, or horizontal bracing. (Commentary: Sec. A.4.7.1. Tier 2: Sec. 5.6.5)
				Comments:

Note: **C** = Compliant **NC** = Noncompliant **N/A** = Not Applicable **U** = Unknown



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920 - Social Science 1

Appendix B
Quick Check Calculations



Subject: Global Data	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page:

GLOBAL DATA

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL


SITE DATA:

Latitude:	37.00236 °N	8635 Kennel Way	USGS Seismic Design Map Application:
Longitude:	122.05809 °W	La Jolla, CA 94166	http://geohazards.usgs.gov/hazardtool/application.php
Site Class:	D (default)	(Stiff Soil)	Site Class [ASCE 41-17, §2.4.1.6]
S _s	= 1.291 g	(USGS) (5% / 50 years)	USGS Mapped (T = 0.2 sec) [ASCE 41-17, §2.4.1.3]
S ₁	= 0.490 g	(USGS) (5% / 50 years)	USGS Mapped (T = 1.0 sec) [ASCE 41-17, §2.4.1.3]
F _a	= 1.200	(Site Class D)	Site Coefficient (T = 0.2 sec) [ASCE 7-16, Table 11.4-1]
F _v	= 1.810	(Site Class D)	Site Coefficient (T = 1.0 sec) [ASCE 7-16, Table 11.4-2]
S _{XS}	= 1.549 g	= F _a S _s	Site-Adjusted Design (T = 0.2 sec) [ASCE 41-17, Eq. 2-1]
S _{X1}	= 0.887 g	= F _v S ₁	Site-Adjusted Design (T = 1.0 sec) [ASCE 41-17, Eq. 2-2]

BUILDING DATA:

Building Type:	S2	(Steel Braced Frames with Stiff Diaphragms)	[ASCE 41-17, Table 3-1]
Year Built:	1989		
Number of Stories:	5 stories		
Parapet Height:	11.00 ft		
Roof Height:	58.00 ft		
Total Area:	34,000 sf		

Level	Height [ft]	Elevation [ft]	Length _{N-S} [ft]	Length _{E-W} [ft]	Area [sf]	Diaphragm Stiffness	Diaphragm Description
Roof	12.0	58.0	100	80	8,000	Rigid	Concrete Fill over Metal Deck
5th	12.0	46.0	100	80	8,000	Rigid	Concrete Fill over Metal Deck
4th	12.0	34.0	100	80	8,000	Rigid	Concrete Fill over Metal Deck
3rd	12.0	22.0	100	80	8,000	Rigid	Concrete Fill over Metal Deck
2nd	10.0	10.0	100	80	8,000	Rigid	Concrete Fill over Metal Deck
1st	0.0	0.0	100	20	2,000	Rigid	Concrete Fill over Metal Deck



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

ROOF TYPE: ROOF

	Roofing / Re-roofing	@	5.0 psf	5.0 psf	y
0.5 in	Rock Ballast (Gravel)	@	8.0 psf per inch	0.0 psf	n
3 ply	Ready Roofing	@	0.3 psf per ply	0.0 psf	n
5 ply	Felt Roofing	@	0.5 psf per ply	0.0 psf	n
0.25 in	Slate	@	40.0 psf per inch	0.0 psf	n
	Shingles (Asphalt)	@	2.0 psf	0.0 psf	n
	Copper or Tin	@	1.0 psf	0.0 psf	n
	Corrugated Asbestos-Cement	@	4.0 psf	0.0 psf	n
	Waterproofing Membranes (Smooth Bituminous)	@	1.5 psf	0.0 psf	n
	Cement Tiles	@	16.0 psf	0.0 psf	n
	Clay Tiles (Spanish)	@	19.0 psf	0.0 psf	n
	Mortar Bed for Clay Tiles	@	10.0 psf	0.0 psf	n
	Roof Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fibrous Glass)	@	1.1 psf per inch	0.0 psf	n
3 in	Vermiculite Concrete	@	2.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2.0 psf per inch	0.0 psf	n
	Diaphragm - core planks	@	35.0 psf	0.0 psf	n
2.5 in	Concrete Slab (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
3.00 in	Concrete Fill (Light Weight)	@	9.2 psf per inch	27.5 psf	y
0.5 in	Concrete Overpour (Light Weight)	@	9.2 psf per inch	0.0 psf	n
18 ga	Bare Metal Deck	@	3.0 psf	3.0 psf	y
2 in	Wood Decking	@	2.5 psf per inch	0.0 psf	n
2 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
	Framing	@	20.0 psf	0.0 psf	n
6.66 ft O.C.	Steel Beams	@	26.0 plf	3.9 psf	y
20 ft O.C.	Steel Girders	@	35.0 plf	1.8 psf	y
2 ft O.C.	Wood Sub-Purlins	@	1.8 plf	0.0 psf	n
8 ft O.C.	Wood Purlins	@	3.0 plf	0.0 psf	n
20 ft O.C.	Wood Girders	@	5.0 plf	0.0 psf	n
12.75 ft O.C.	Concrete Beams	@	800.0 plf	0.0 psf	n
20 ft O.C.	Concrete Girders	@	300.0 plf	0.0 psf	n
12.00 ft trib. ht.	Typical Columns (A _{trib} = 400 sf)	@	49.0 plf	1.5 psf	y
	Ceiling	@	5.0 psf	5.0 psf	y
0.5 in	Gypsum Board Ceiling	@	4.4 psf per inch	0.0 psf	n
	Acoustical Fiber Board	@	1.0 psf	0.0 psf	n
	Plaster Ceiling (On Tile)	@	5.0 psf	0.0 psf	n
	Suspended Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Suspended Steel Channel System	@	2.0 psf	0.0 psf	n
	Suspended Wood Furring System	@	2.5 psf	0.0 psf	n
	T-bar Ceiling System	@	3.0 psf	0.0 psf	n
100% floor area	Interior Partitions (Below)	@	5.0 psf	5.0 psf	y
	M.E.P.	@	5.0 psf	5.0 psf	y
	Miscellaneous	@	1.4 psf	1.4 psf	y
	Other	@	0.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

ROOF WEIGHT = 60.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

FLOOR TYPE: **FLR-5**

	Flooring	@	15.0 psf	15.0 psf	y
1 in	Floor Tiles (Terrazzo)	@	13.0 psf per inch	0.0 psf	n
0.75 in	Wood Flooring (Hardwood)	@	4.6 psf per inch	0.0 psf	n
2 in	Wood Blocks	@	3.3 psf per inch	0.0 psf	n
2 in	Asphalt Blocks	@	12.0 psf per inch	0.0 psf	n
0.75 in	Mastic	@	12.0 psf per inch	0.0 psf	n
1 in	Cement Finish	@	12.0 psf per inch	0.0 psf	n
2 in	Mortar Bed	@	12.0 psf per inch	0.0 psf	n
2 in	Floor Fill (Stone Concrete)	@	12.0 psf per inch	0.0 psf	n
0.75 in	Subflooring	@	4.0 psf per inch	0.0 psf	n
	Marble & Mortar, Stone Concrete	@	33.0 psf	0.0 psf	n
	Solid Flat Tile, 1-in Mortar Base	@	23.0 psf	0.0 psf	n
	Floor Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fibrous Glass)	@	1.1 psf per inch	0.0 psf	n
3 in	Vermiculite Concrete	@	2.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Diaphragm	@	20.0 psf	0.0 psf	n
3 in	Concrete Slab (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
4.25 in	Concrete Fill (Light Weight)	@	9.2 psf per inch	39.0 psf	y
0.5 in	Concrete Overpour (Light Weight)	@	9.2 psf per inch	0.0 psf	n
18 ga	Bare Metal Deck	@	3.0 psf	3.0 psf	y
2 in	Wood Decking	@	2.5 psf per inch	0.0 psf	n
2 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
	Framing	@	20.0 psf	0.0 psf	n
10 ft O.C.	Steel Beams	@	31.0 plf	3.1 psf	y
20 ft O.C.	Steel Girders	@	40.0 plf	2.0 psf	y
2 ft O.C.	Wood Sub-Purlins	@	1.8 plf	0.0 psf	n
8 ft O.C.	Wood Purlins	@	3.0 plf	0.0 psf	n
20 ft O.C.	Wood Girders	@	5.0 plf	0.0 psf	n
8 ft O.C.	Concrete Beams	@	200.0 plf	0.0 psf	n
20 ft O.C.	Concrete Girders	@	300.0 plf	0.0 psf	n
12.0 ft trib. ht.	Typical Columns (A _{trib} = 400 sf)	@	60.0 plf	1.8 psf	y
	Ceiling	@	5.0 psf	5.0 psf	y
0.5 in	Gypsum Board Ceiling	@	4.4 psf per inch	0.0 psf	n
	Acoustical Fiber Board	@	1.0 psf	0.0 psf	n
	Plaster Ceiling (On Tile)	@	5.0 psf	0.0 psf	n
	Suspended Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Suspended Steel Channel System	@	2.0 psf	0.0 psf	n
	Suspended Wood Furring System	@	2.5 psf	0.0 psf	n
	T-bar Ceiling System	@	3.0 psf	0.0 psf	n
100% floor area	Interior Partitions (Above & Below)	@	10.0 psf	10.0 psf	y
	M.E.P.	@	5.0 psf	5.0 psf	y
	Miscellaneous	@	1.1 psf	1.1 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

FLR-5 WEIGHT = 86.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

FLOOR TYPE: FLR-4

	Flooring		@	15.0 psf	15.0 psf	y
1 in	Floor Tiles	(Terrazzo)	@	13.0 psf per inch	0.0 psf	n
0.75 in	Wood Flooring	(Hardwood)	@	4.6 psf per inch	0.0 psf	n
2 in	Wood Blocks		@	3.3 psf per inch	0.0 psf	n
2 in	Asphalt Blocks		@	12.0 psf per inch	0.0 psf	n
0.75 in	Mastic		@	12.0 psf per inch	0.0 psf	n
1 in	Cement Finish		@	12.0 psf per inch	0.0 psf	n
2 in	Mortar Bed		@	12.0 psf per inch	0.0 psf	n
2 in	Floor Fill	(Stone Concrete)	@	12.0 psf per inch	0.0 psf	n
0.75 in	Subflooring		@	4.0 psf per inch	0.0 psf	n
	Marble & Mortar, Stone Concrete		@	33.0 psf	0.0 psf	n
	Solid Flat Tile, 1-in Mortar Base		@	23.0 psf	0.0 psf	n
	Floor Insulation		@	1.0 psf	1.0 psf	y
1 in	Insulation	(Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards	(Fibrous Glass)	@	1.1 psf per inch	0.0 psf	n
3 in	Vermiculite Concrete		@	2.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing		@	2 psf per inch	0.0 psf	n
	Diaphragm		@	20.0 psf	0.0 psf	n
3 in	Concrete Slab	(Normal Weight)	@	12.5 psf per inch	0.0 psf	n
4.25 in	Concrete Fill	(Light Weight)	@	9.2 psf per inch	39.0 psf	y
0.5 in	Concrete Overpour	(Light Weight)	@	9.2 psf per inch	0.0 psf	n
18 ga	Bare Metal Deck		@	3.0 psf	3.0 psf	y
2 in	Wood Decking		@	2.5 psf per inch	0.0 psf	n
2 in	Wood Sheathing		@	3.0 psf per inch	0.0 psf	n
0.5 in	Plywood		@	3.2 psf per inch	0.0 psf	n
	Framing		@	20.0 psf	0.0 psf	n
10 ft O.C.	Steel Beams		@	31.0 plf	3.1 psf	y
20 ft O.C.	Steel Girders		@	40.0 plf	2.0 psf	y
2 ft O.C.	Wood Sub-Purlins		@	1.8 plf	0.0 psf	n
8 ft O.C.	Wood Purlins		@	3.0 plf	0.0 psf	n
20 ft O.C.	Wood Girders		@	5.0 plf	0.0 psf	n
8 ft O.C.	Concrete Beams		@	200.0 plf	0.0 psf	n
20 ft O.C.	Concrete Girders		@	300.0 plf	0.0 psf	n
12.0 ft trib. ht.	Typical Columns	(A _{trib} = 400 sf)	@	60.0 plf	1.8 psf	y
	Ceiling		@	5.0 psf	5.0 psf	y
0.5 in	Gypsum Board Ceiling		@	4.4 psf per inch	0.0 psf	n
	Acoustical Fiber Board		@	1.0 psf	0.0 psf	n
	Plaster Ceiling	(On Tile)	@	5.0 psf	0.0 psf	n
	Suspended Metal Lath & Plaster	(Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Suspended Steel Channel System		@	2.0 psf	0.0 psf	n
	Suspended Wood Furring System		@	2.5 psf	0.0 psf	n
	T-bar Ceiling System		@	3.0 psf	0.0 psf	n
100% floor area	Interior Partitions	(Above & Below)	@	10.0 psf	10.0 psf	y
	M.E.P.		@	5.0 psf	5.0 psf	y
	Miscellaneous		@	1.1 psf	1.1 psf	y
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n

FLR-4 WEIGHT = 86.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

FLOOR TYPE: **FLR-3**

	Flooring	@	15.0 psf	15.0 psf	y
1 in	Floor Tiles (Terrazzo)	@	13.0 psf per inch	0.0 psf	n
0.75 in	Wood Flooring (Hardwood)	@	4.6 psf per inch	0.0 psf	n
2 in	Wood Blocks	@	3.3 psf per inch	0.0 psf	n
2 in	Asphalt Blocks	@	12.0 psf per inch	0.0 psf	n
0.75 in	Mastic	@	12.0 psf per inch	0.0 psf	n
1 in	Cement Finish	@	12.0 psf per inch	0.0 psf	n
2 in	Mortar Bed	@	12.0 psf per inch	0.0 psf	n
2 in	Floor Fill (Stone Concrete)	@	12.0 psf per inch	0.0 psf	n
0.75 in	Subflooring	@	4.0 psf per inch	0.0 psf	n
	Marble & Mortar, Stone Concrete	@	33.0 psf	0.0 psf	n
	Solid Flat Tile, 1-in Mortar Base	@	23.0 psf	0.0 psf	n
	Floor Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fibrous Glass)	@	1.1 psf per inch	0.0 psf	n
3 in	Vermiculite Concrete	@	2.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Diaphragm	@	20.0 psf	0.0 psf	n
3 in	Concrete Slab (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
4.25 in	Concrete Fill (Light Weight)	@	9.2 psf per inch	39.0 psf	y
0.5 in	Concrete Overpour (Light Weight)	@	9.2 psf per inch	0.0 psf	n
18 ga	Bare Metal Deck	@	3.0 psf	3.0 psf	y
2 in	Wood Decking	@	2.5 psf per inch	0.0 psf	n
2 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
	Framing	@	20.0 psf	0.0 psf	n
10 ft O.C.	Steel Beams	@	31.0 plf	3.1 psf	y
20 ft O.C.	Steel Girders	@	40.0 plf	2.0 psf	y
2 ft O.C.	Wood Sub-Purlins	@	1.8 plf	0.0 psf	n
8 ft O.C.	Wood Purlins	@	3.0 plf	0.0 psf	n
20 ft O.C.	Wood Girders	@	5.0 plf	0.0 psf	n
8 ft O.C.	Concrete Beams	@	200.0 plf	0.0 psf	n
20 ft O.C.	Concrete Girders	@	300.0 plf	0.0 psf	n
12.0 ft trib. ht.	Typical Columns (A _{trib} = 400 sf)	@	60.0 plf	1.8 psf	y
	Ceiling	@	5.0 psf	5.0 psf	y
0.5 in	Gypsum Board Ceiling	@	4.4 psf per inch	0.0 psf	n
	Acoustical Fiber Board	@	1.0 psf	0.0 psf	n
	Plaster Ceiling (On Tile)	@	5.0 psf	0.0 psf	n
	Suspended Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Suspended Steel Channel System	@	2.0 psf	0.0 psf	n
	Suspended Wood Furring System	@	2.5 psf	0.0 psf	n
	T-bar Ceiling System	@	3.0 psf	0.0 psf	n
100% floor area	Interior Partitions (Above & Below)	@	10.0 psf	10.0 psf	y
	M.E.P.	@	5.0 psf	5.0 psf	y
	Miscellaneous	@	1.1 psf	1.1 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

FLR-3 WEIGHT = 86.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

FLOOR TYPE: FLR-2

	Flooring		@	15.0 psf	15.0 psf	y
1 in	Floor Tiles	(Terrazzo)	@	13.0 psf per inch	0.0 psf	n
0.75 in	Wood Flooring	(Hardwood)	@	4.6 psf per inch	0.0 psf	n
2 in	Wood Blocks		@	3.3 psf per inch	0.0 psf	n
2 in	Asphalt Blocks		@	12.0 psf per inch	0.0 psf	n
0.75 in	Mastic		@	12.0 psf per inch	0.0 psf	n
1 in	Cement Finish		@	12.0 psf per inch	0.0 psf	n
2 in	Mortar Bed		@	12.0 psf per inch	0.0 psf	n
2 in	Floor Fill	(Stone Concrete)	@	12.0 psf per inch	0.0 psf	n
0.75 in	Subflooring		@	4.0 psf per inch	0.0 psf	n
	Marble & Mortar, Stone Concrete		@	33.0 psf	0.0 psf	n
	Solid Flat Tile, 1-in Mortar Base		@	23.0 psf	0.0 psf	n
	Floor Insulation		@	1.0 psf	1.0 psf	y
1 in	Insulation	(Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards	(Fibrous Glass)	@	1.1 psf per inch	0.0 psf	n
3 in	Vermiculite Concrete		@	2.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing		@	2 psf per inch	0.0 psf	n
	Diaphragm		@	20.0 psf	0.0 psf	n
3 in	Concrete Slab	(Normal Weight)	@	12.5 psf per inch	0.0 psf	n
4.25 in	Concrete Fill	(Light Weight)	@	9.2 psf per inch	39.0 psf	y
0.5 in	Concrete Overpour	(Light Weight)	@	9.2 psf per inch	0.0 psf	n
18 ga	Bare Metal Deck		@	3.0 psf	3.0 psf	y
2 in	Wood Decking		@	2.5 psf per inch	0.0 psf	n
2 in	Wood Sheathing		@	3.0 psf per inch	0.0 psf	n
0.5 in	Plywood		@	3.2 psf per inch	0.0 psf	n
	Framing		@	20.0 psf	0.0 psf	n
10 ft O.C.	Steel Beams		@	31.0 plf	3.1 psf	y
20 ft O.C.	Steel Girders		@	40.0 plf	2.0 psf	y
2 ft O.C.	Wood Sub-Purlins		@	1.8 plf	0.0 psf	n
8 ft O.C.	Wood Purlins		@	3.0 plf	0.0 psf	n
20 ft O.C.	Wood Girders		@	5.0 plf	0.0 psf	n
8 ft O.C.	Concrete Beams		@	200.0 plf	0.0 psf	n
20 ft O.C.	Concrete Girders		@	300.0 plf	0.0 psf	n
12.0 ft trib. ht.	Typical Columns	(A _{trib} = 400 sf)	@	60.0 plf	1.8 psf	y
	Ceiling		@	5.0 psf	5.0 psf	y
0.5 in	Gypsum Board Ceiling		@	4.4 psf per inch	0.0 psf	n
	Acoustical Fiber Board		@	1.0 psf	0.0 psf	n
	Plaster Ceiling	(On Tile)	@	5.0 psf	0.0 psf	n
	Suspended Metal Lath & Plaster	(Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Suspended Steel Channel System		@	2.0 psf	0.0 psf	n
	Suspended Wood Furring System		@	2.5 psf	0.0 psf	n
	T-bar Ceiling System		@	3.0 psf	0.0 psf	n
100% floor area	Interior Partitions	(Above & Below)	@	10.0 psf	10.0 psf	y
	M.E.P.		@	5.0 psf	5.0 psf	y
	Miscellaneous		@	1.1 psf	1.1 psf	y
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n
	Other		@	1.0 psf	0.0 psf	n

FLR-2 WEIGHT = 86.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: **WALL-P**

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
8 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Solid Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 100%
WALL-P WEIGHT = 26.0 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: **WALL-R**

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
8 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Solid Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 80%
WALL-R WEIGHT = 22.4 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: WALL-5

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
8 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 80%
WALL-5 WEIGHT = 22.4 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: WALL-4

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
8 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 80%
WALL-4 WEIGHT = 22.4 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: **WALL-3**

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
10 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 80%
WALL-3 WEIGHT = 22.4 psf



Subject: Weight Take Off	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
Checked By:		Page


WEIGHT TAKEOFF

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

WALL TYPE: **WALL-2**

	Wall Covering	@	4.0 psf	4.0 psf	y
1 in	Exterior Stucco	@	11.4 psf per inch.	0.0 psf	n
1 in	Wood Sheathing	@	3.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Sheathing	@	4.0 psf per inch	0.0 psf	n
0.5 in	Gypsum Wallboard	@	4.4 psf per inch	0.0 psf	n
	Porcelain Enamel Panels	@	5.0 psf	0.0 psf	n
	Metal Lath & Plaster (Gypsum Plaster)	@	10.0 psf	0.0 psf	n
	Wall Insulation	@	1.0 psf	1.0 psf	y
1 in	Insulation (Rigid)	@	1.5 psf per inch	0.0 psf	n
1 in	Insulation Boards (Fiber Board)	@	1.5 psf per inch	0.0 psf	n
0.5 in	Fire Proofing	@	2 psf per inch	0.0 psf	n
	Wall Framing	@	20.0 psf	20.0 psf	y
10 in	Concrete Wall (Normal Weight)	@	12.5 psf per inch	0.0 psf	n
8 in	CMU Wall w/ Full Grouting (Normal Weight)	@	83.0 psf	0.0 psf	n
8 in	Solid CMU Wall (Normal Weight)	@	87.0 psf	0.0 psf	n
4 in	HCB Wall w/ Full Grouting	@	38.0 psf	0.0 psf	n
3.5 in	Clay Brick Wall	@	11.1 psf per inch	0.0 psf	n
0.5 in	Plywood	@	3.2 psf per inch	0.0 psf	n
16 in O.C.	Wood Studs (2 x 4)	@	1.1 plf	0.0 psf	n
16 in O.C.	Metal Channel Studs	@	2.0 plf	0.0 psf	n
8 ft O.C.	Steel Girts	@	6.0 plf	0.0 psf	n
	Miscellaneous	@	1.0 psf	1.0 psf	y
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n
	Other	@	1.0 psf	0.0 psf	n

Solid Wall Weight = 26.0 psf
 Window & Door Weight = 8.0 psf
 % Solid Wall = 80%
WALL-2 WEIGHT = 22.4 psf



Subject: Seismic Mass	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page

SEISMIC MASS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

ROOF/FLOOR WEIGHT SUMMARY:


Level Type	Weight [psf]
ROOF	60
FLR-5	86
FLR-4	86
FLR-3	86
FLR-2	86

WALL WEIGHT SUMMARY:

Wall Type	Weight [psf]		
	Net	Solid	Openings
WALL-P	26.0	26	8
WALL-R	22.4	26	8
WALL-5	22.4	26	8
WALL-4	22.4	26	8
WALL-3	22.4	26	8
WALL-2	22.4	26	8

SEISMIC MASS SUMMARY:

Level	FLOOR			WALL ABOVE				WALL BELOW				TOTAL WEIGHT [kips]
	Level Type	Weight [psf]	Area [sf]	Wall Type	Weight [psf]	Length [ft]	Height [ft]	Wall Type	Weight [psf]	Length [ft]	Height [ft]	
Roof	ROOF	60	8,000	WALL-P	26.0	0	11.00	WALL-R	22.4	0	6.00	480
5th	FLR-5	86	8,000	WALL-R	22.4	360	6.00	WALL-5	22.4	360	6.00	785
4th	FLR-4	86	8,000	WALL-5	22.4	360	6.00	WALL-4	22.4	360	6.00	785
3rd	FLR-3	86	8,000	WALL-4	22.4	360	6.00	WALL-3	22.4	360	6.00	785
2nd	FLR-2	86	8,000	WALL-3	22.4	360	6.00	WALL-2	22.4	360	5.00	777
												TOTAL 3,611



Subject: Seismic Forces	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page:

SEISMIC FORCES

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE: S2 (Steel Braced Frames with Stiff Diaphragms) [ASCE 41-17, Table 3-1]
SITE CLASS: D (default) #N/A [ASCE 41-17, §2.4.1.6]


DESIGN SPECTRAL ACCELERATIONS:

S_{XS} = 1.549 g (BSE-2E) Site-Adjusted Design (T = 0.2 sec) [ASCE 41-17, Eq. 2-1]
 S_{X1} = 0.887 g (BSE-2E) Site-Adjusted Design (T = 1.0 sec) [ASCE 41-17, Eq. 2-2]

BUILDING PERIOD:

h_n = 58.0 ft (Base to Roof) Building Height [ASCE 41-17, §4.4.2.4]
 C_t = 0.020 (Building Type S2) Period Coefficient [ASCE 41-17, §4.4.2.4]
 β = 0.750 (Building Type S2) Period Exponent [ASCE 41-17, §4.4.2.4]
 T = 0.420 sec = $C_t h_n^\beta$ Fundamental Period [ASCE 41-17, Eq. 4-4]

RESPONSE SPECTRUM:

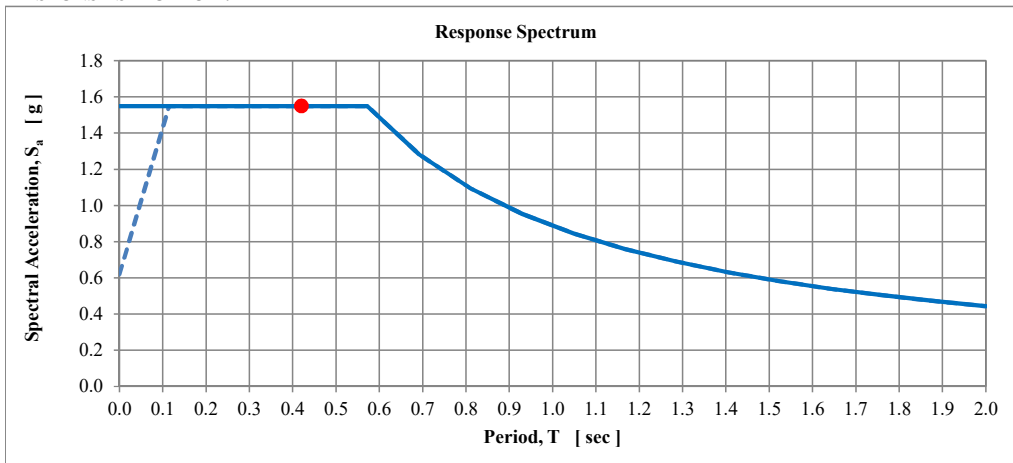

PSEUDO LATERAL FORCE:


n = 5 ($n \geq 4$) Total Number of Stories
 C = 1.0 (Building Type S2) Modification Factor [ASCE 41-17, Table 4-7]
 S_a = 1.549 g = $\text{MIN} \{ S_{X1} / T, S_{XS} \}$ Spectral Acceleration [ASCE 41-17, Eq. 4-3]
 V = **1.549 W** = $C S_a W$ Pseudo Lateral Force [ASCE 41-17, Eq. 4-1]

VERTICAL DISTRIBUTION OF SEISMIC FORCES:

k = 1.00 ($T \leq 0.5$ sec) Seismic Distribution Exponent [ASCE 41-17, §4.4.2.2]

Level	h_x [ft]	w_x [kips]	$w_x h_x^k$	C_{vx}	F_x [kips]	V_j [kips]
Roof	58.0	480	27,840	0.24	1,347	1,347
5th	46.0	785	36,099	0.31	1,746	3,093
4th	34.0	785	26,682	0.23	1,291	4,383
3rd	22.0	785	17,265	0.15	835	5,218
2nd	10.0	777	7,767	0.07	376	5,594
TOTAL	-	3,611	115,653	1.00	5,594	-

$F_x = C_{vx} V = [w_x h_x^k / \sum (w_x h_x^k)] V$ [ASCE 41-17, Eq. 4-2a]
 $V_j = \sum F_x$ [ASCE 41-17, Eq. 4-2b]



Subject: Quick Checks	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page

QUICK CHECKS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE: C2 (Concrete Shear Walls with Stiff Diaphragms) [ASCE 41-17, Table 3-1]

STEEL REINFORCING RATIO CHECK: [ASCE 41-17, §A.3.2.2.2]

Wall Type	t _w [in]	Horizontal Reinforcing					Vertical Reinforcing				
		n _{curtains} [curtains]	Bar Size No.	Spacing [in]	ρ _h	ρ _h ≥ 0.0020	n _{curtains} [curtains]	Bar Size No.	Spacing [in]	ρ _v	ρ _v ≥ 0.0012
WALL-2	10	2	4	10	0.0040	OK	2	4	10	0.0040	OK

AVERAGE SHEAR STRESS CHECK:


f' _c	=	3,000 psi	(ASCE 41 Default)	Concrete Compressive Strength	[ASCE 41-17, Table 4-2]
v _n	=	110 psi	= MAX { 100 psi , 2 √ f' _c }	Shear Wall Capacity	[ASCE 41-17, §A.3.2.2.1]
M _s	=	4.5	COLLAPSE PREVENTION	System Modification Factor	[ASCE 41-17, Table 4-8]
v _{j, avg}	=	(1 / M _s) (V _j / A _w)		Average Shear Wall Stress	[ASCE 41-17, Eq. 4-8]
A _w	=	t _w (L _{w, total} - L _{w, openings})		Net Wall Area	[ASCE 41-17, §4.4.3.3]

North-South Direction:

Level	V _j [kips]	Wall Type	t _w [in]	L _{w, total} [ft]	L _{w, openings} [ft]	L _w [ft]	A _w [in ²]	v _{j, avg} [psi]	DCR	Quick Check
2nd	5,594	WALL-2	10	200	35	165	19,800	63	0.57	OK

East-West Direction:

Level	V _j [kips]	Wall Type	t _w [in]	L _{w, total} [ft]	L _{w, openings} [ft]	L _w [ft]	A _w [in ²]	v _{j, avg} [psi]	DCR	Quick Check
2nd	5,594	WALL-2	10	120	20	100	12,000	104	0.95	OK



Subject: Quick Checks	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page:

QUICK CHECKS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE:	S2	(Steel Braced Frames with Stiff Diaphragms)	[ASCE 41-17, Table 3-1]
FRAME TYPE:	CBF	(Concentrically Braced Frame)	
CONFIGURATION:	Inverted V	(Inverted V-Bracing)	
BRACE TYPE:	W	(Wide Flange Braces)	
AXIAL LOAD:	T+C	(Tension and Compression)	
LOAD DIRECTION:	N-S		

FRAME PROPERTIES:

Level	n _f [frames]	n _c [columns]	n _{bays} [bays]	n _{br} [braces]	L _f [ft]	L _{typical bay} [ft]	DL [psf]	LL [psf]	A _{trib} [ft ²]	P _D [kips]	P _L [kips]
Roof	2	8	4	4	80.0	20	60	20	200	12	4
5th	2	8	4	8	80.0	20	86	50	200	29	21
4th	2	8	4	8	80.0	20	86	50	200	46	38
3rd	2	8	4	8	80.0	20	86	50	200	64	56
2nd	2	8	4	8	80.0	20	86	50	200	81	73

FRAME MEMBER PROPERTIES:

[ASCE 41-17 §4.2.3]

Material Properties:


F _{yc}	=	37 ksi	(ASTM A36 / Structural)	Column Yield Stress	(ASCE 41 Default)	[ASCE 41-17, §4.2.3]
F _{ybr}	=	37 ksi	(ASTM A36 / Structural)	Brace Yield Stress	(ASCE 41 Default)	[ASCE 41-13, Table 4-5]
E	=	29,000 ksi		Modulus of Elasticity		[ASCE 41-17, §4.2.3]

Column Properties:

Level	Section	Bending Axis	L _c [ft]	A _c [in ²]
Roof	W10x60	x	12.0	17.7
5th	W10x60	x	12.0	17.7
4th	W10x60	x	12.0	17.7
3rd	W10x60	x	12.0	17.7
2nd	W10x60	x	10.0	17.7

Brace Properties:

Level	Section	L _{br,x} [ft]	L _{br,y} [ft]	L _{br} [ft]	A _{br} [in ²]	d _{br} / t _{br}	b/t	λ _r	λ _{hd}	Kl/r
Roof	W10x49	10.0	12.0	15.6	14.40	n/a	8.93	15.68	10.68	73.80
5th	W10x60	10.0	12.0	15.6	17.70	n/a	7.41	15.68	10.68	72.94
4th	W10x60	10.0	12.0	15.6	17.70	n/a	7.41	15.68	10.68	72.94
3rd	W10x60	10.0	12.0	15.6	17.70	n/a	7.41	15.68	10.68	72.94
2nd	W10x60	10.0	10.0	14.1	17.70	n/a	7.41	15.68	10.68	66.03



Subject: Quick Checks	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page

QUICK CHECKS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE: S2 (Steel Braced Frames with Stiff Diaphragms) [ASCE 41-17, Table 3-1]
LOAD DIRECTION: N-S

COLUMN AXIAL STRESS CHECK: [ASCE 41-17, §A.3.1.3.2]


M_s = 2.5 COLLAPSE PREVENTION System Modification Factor [ASCE 41-17, §4.4.3.6]
 F_{yc} = 37 ksi (ASTM A36 / Structural) Column Yield Stress [ASCE 41-17, §4.2.3]
 $P_{n,E} / A_c$ = 11.1 ksi = 0.30 F_{yc} Seismic Axial Stress Capacity [ASCE 41-17, §A.3.1.3.2]
 $P_{n,G} / A_c$ = 3.7 ksi = 0.10 F_{yc} Gravity Axial Stress Capacity [ASCE 41-17, §A.3.1.3.2]
 $M_{x,ot}$ = $\Sigma (F_x h_x)$ Global Overturning Moment [ASCE 41-17, §4.4.3.6]
 P_E = $(1 / M_s) (M_{x,ot} / n_f) / L_f$ Seismic Axial Load due to Overturning [ASCE 41-17, §4.4.3.6]
 P_G = $P_D + P_L$ Unfactored Gravity Load [ASCE 41-17, §A.3.1.3.2]
 P_D = $\Sigma (DL A_{trib})$ Gravity Dead Load [ASCE 41-17, §4.4.3.6]
 P_L = $\Sigma (LL A_{trib})$ Gravity Live Load [ASCE 41-17, §4.4.3.6]

Level	Section	A _c [in ²]	h _x [ft]	F _x [kips]	M _{x,ot} [k-ft]	P _E [kips]	P _E / F _{yc} A _c	P _G [kips]	P _G / F _{yc} A _c	DCR		Quick Check
										Seismic	Gravity	
Roof	W10x60	17.7	58.0	1,347	16,160	40	0.06	16	0.02	0.21	0.24	OK
5th	W10x60	17.7	46.0	1,746	53,273	133	0.20	50	0.08	0.68	0.77	OK
4th	W10x60	17.7	34.0	1,291	105,873	265	0.40	85	0.13	1.35	1.29	NO GOOD
3rd	W10x60	17.7	22.0	835	168,495	421	0.64	119	0.18	2.14	1.82	NO GOOD
2nd	W10x60	17.7	10.0	376	224,437	561	0.86	154	0.23	2.86	2.35	NO GOOD

BRACE AXIAL STRESS CHECK: [ASCE 41-17, §A.3.3.1.2]

M_s = { 7.0 (Tube, $d_{br} / t_{br} < 90 / \sqrt{F_{yebr}}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Tube, $d_{br} / t_{br} > 190 / \sqrt{F_{yebr}}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 7.0 (Pipe, $d_{br} / t_{br} < 1500 / F_{yebr}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Pipe, $d_{br} / t_{br} > 6000 / F_{yebr}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Tension-Only Braces) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Cold-formed steel strap-braced w/) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 7.0 (All Other Brace Types) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 F_{ybr} = 37 ksi (ASTM A36 / Structural) Brace Yield Stress [ASCE 41-13, Table 4-5]
 F_{yebr} = 46 ksi = 1.25 F_{ybr} Brace Expected Yield Stress [ASCE 41-17, §4.4.3.4]
 f_{nbr} = 19 ksi = 0.50 F_{ybr} Brace Axial Stress Capacity [ASCE 41-17, §A.3.3.1.2]
 $f_{j,avg}$ = $(1 / M_s) (V_j / (L_{br,x} n_{br})) (L_{br} / A_{br})$ Average Brace Axial Stress [ASCE 41-17, Eq. 4-9]

Level	V _j [kips]	n _{br} [braces]	L _{br,x} [ft]	L _{br} [ft]	A _{br} [in ²]	d _{br} / t _{br}	M _s	f _{j,avg} [ksi]	DCR	Quick Check
Roof	1,347	4	10.0	15.6	14.40	n/a	7.00	5.2	0.28	OK
5th	3,093	8	10.0	15.6	17.70	n/a	7.00	4.9	0.26	OK
4th	4,383	8	10.0	15.6	17.70	n/a	7.00	6.9	0.37	OK
3rd	5,218	8	10.0	15.6	17.70	n/a	7.00	8.2	0.44	OK
2nd	5,594	8	10.0	14.1	17.70	n/a	7.00	8.0	0.43	OK



Subject: Quick Checks	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page:

QUICK CHECKS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE: S2 (Steel Braced Frames with Stiff Diaphragms) [ASCE 41-17, Table 3-1]

LOAD DIRECTION: E-W

FRAME PROPERTIES:

Level	n _f [frames]	n _c [columns]	n _{bays} [bays]	n _{br} [braces]	L _f [ft]	L _{typical bay} [ft]	DL [psf]	LL [psf]	A _{trib} [ft ²]	P _D [kips]	P _L [kips]
Roof	2	4	0	0	80.0	20.0	60	20	200	12	4
5th	2	8	4	4	80.0	20.0	86	50	200	29	21
4th	2	8	4	4	80.0	20.0	86	50	200	46	38
3rd	2	8	4	4	80.0	20.0	86	50	200	64	56
2nd	2	8	4	4	80.0	20.0	86	50	200	81	73

FRAME MEMBER PROPERTIES:

[ASCE 41-17, §4.2.3]

Material Properties:

(ASCE 41 Default)


F _{yc}	=	37 ksi	(ASTM A36 / Structural)	Column Yield Stress	[ASCE 41-17, §4.2.3]
F _{ybr}	=	37 ksi	(ASTM A36 / Structural)	Brace Yield Stress	[ASCE 41-13, Table 4-5]
E	=	29,000 ksi		Modulus of Elasticity	[ASCE 41-17, §4.2.3]

Column Properties:

Level	Section	Bending Axis	L _c [ft]	A _c [in ²]
Roof	W10x60	x	12.0	17.7
5th	W10x60	x	12.0	17.7
4th	W10x60	x	12.0	17.7
3rd	W10x60	x	12.0	17.7
2nd	W10x60	x	10.0	17.7

Brace Properties:

Level	Section	L _{br,x} [ft]	L _{br,y} [ft]	L _{br} [ft]	A _{br} [in ²]	d _{br} / t _{br}	b/t	λ _r	λ _{hd}	KI/r
Roof		20.0	12.0	23.3	#N/A	n/a	#N/A	15.68	10.68	#N/A
5th	W10x60	20.0	12.0	23.3	17.70	n/a	7.41	15.68	10.68	108.90
4th	W10x60	20.0	12.0	23.3	17.70	n/a	7.41	15.68	10.68	108.90
3rd	W10x60	20.0	12.0	23.3	17.70	n/a	7.41	15.68	10.68	108.90
2nd	W10x60	20.0	10.0	22.4	17.70	n/a	7.41	15.68	10.68	104.41



Subject: Quick Checks	Job Number: B9956006.00	Date: 06/28/19
Job: UCSC Tier 1 Seismic Evaluations CAAN #7920.0	By: JSW	Section:
	Checked By:	Page:

QUICK CHECKS

ASCE 41-17 SEISMIC EVALUATION & RETROFIT OF EXISTING BUILDINGS
 CHAPTER 4 - TIER 1 EVALUATION
 LINEAR STATIC PROCEDURE
 COLLAPSE PREVENTION
 BSE-2E HAZARD LEVEL

BUILDING TYPE: S2 (Steel Braced Frames with Stiff Diaphragms) [ASCE 41-17, Table 3-1]
LOAD DIRECTION: E-W

COLUMN AXIAL STRESS CHECK: [ASCE 41-17, §A.3.1.3.2]

M_s = 2.5 COLLAPSE PREVENTION System Modification Factor [ASCE 41-17, §4.4.3.6]
 F_{yc} = 37 ksi (ASTM A36 / Structural) Column Yield Stress [ASCE 41-17, §4.2.3]
 $P_{n,E} / A_c$ = 11.1 ksi = 0.30 F_{yc} Seismic Axial Stress Capacity [ASCE 41-17, §A.3.1.3.2]
 $P_{n,G} / A_c$ = 3.7 ksi = 0.10 F_{yc} Gravity Axial Stress Capacity [ASCE 41-17, §A.3.1.3.2]
 $M_{x,ot}$ = $\Sigma (F_x h_x)$ Global Overturning Moment [ASCE 41-17, §4.4.3.6]
 P_E = $(1 / M_s) (M_{x,ot} / n_f) / L_f$ Seismic Axial Load due to Overturning [ASCE 41-17, §4.4.3.6]
 P_G = $P_D + P_L$ Unfactored Gravity Load [ASCE 41-17, §A.3.1.3.2]
 P_D = $\Sigma (DL A_{trib})$ Gravity Dead Load [ASCE 41-17, §4.4.3.6]
 P_L = $\Sigma (LL A_{trib})$ Gravity Live Load [ASCE 41-17, §4.4.3.6]

Level	Section	A _c [in ²]	h _x [ft]	F _x [kips]	M _{x,ot} [k-ft]	P _E [kips]	P _E / F _{yc} A _c	P _G [kips]	P _G / F _{yc} A _c	DCR		Quick Check
										Seismic	Gravity	
Roof	W10x60	17.7	58.0	1,347	16,160	40	0.06	16	0.02	0.21	0.24	OK
5th	W10x60	17.7	46.0	1,746	53,273	133	0.20	50	0.08	0.68	0.77	OK
4th	W10x60	17.7	34.0	1,291	105,873	265	0.40	85	0.13	1.35	1.29	NO GOOD
3rd	W10x60	17.7	22.0	835	168,495	421	0.64	119	0.18	2.14	1.82	NO GOOD
2nd	W10x60	17.7	10.0	376	224,437	561	0.86	154	0.23	2.86	2.35	NO GOOD

BRACE AXIAL STRESS CHECK: [ASCE 41-17, §A.3.3.1.2]

M_s = { 7.0 (Tube, $d_{br} / t_{br} < 90 / \sqrt{F_{yebr}}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Tube, $d_{br} / t_{br} > 190 / \sqrt{F_{yebr}}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 7.0 (Pipe, $d_{br} / t_{br} < 1500 / F_{yebr}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Pipe, $d_{br} / t_{br} > 6000 / F_{yebr}$) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Tension-Only Braces) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 3.5 (Cold-formed steel strap-braced w/) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 7.0 (All Other Brace Types) System Modification Factor (CP) [ASCE 41-17, Table 4-9]
 F_{ybr} = 37 ksi (ASTM A36 / Structural) Brace Yield Stress [ASCE 41-13, Table 4-5]
 F_{yebr} = 46 ksi = 1.25 F_{ybr} Brace Expected Yield Stress [ASCE 41-17, §4.4.3.4]
 f_{nbr} = 19 ksi = 0.50 F_{ybr} Brace Axial Stress Capacity [ASCE 41-17, §A.3.3.1.2]
 $f_{j,avg}$ = $(1 / M_s) (V_j / (L_{br,x} n_{br})) (L_{br} / A_{br})$ Average Brace Axial Stress [ASCE 41-17, Eq. 4-9]

Level	V _j [kips]	n _{br} [braces]	L _{br,x} [ft]	L _{br} [ft]	A _{br} [in ²]	d _{br} / t _{br}	M _s	f _{j,avg} [ksi]	DCR	Quick Check
Roof	1,347	0	20.0	23.3	#N/A	n/a	7.00	#DIV/0!	#DIV/0!	#DIV/0!
5th	3,093	4	20.0	23.3	17.70	n/a	7.00	7.3	0.39	OK
4th	4,383	4	20.0	23.3	17.70	n/a	7.00	10.3	0.56	OK
3rd	5,218	4	20.0	23.3	17.70	n/a	7.00	12.3	0.66	OK
2nd	5,594	4	20.0	22.4	17.70	n/a	7.00	12.6	0.68	OK



Purpose: To check if the W10x60 brace connection can develop the full tensile capacity of the diagonal

Procedure: The calculation steps are as follows

Step 1: Check the brace net section rupture capacity

Step 2: Check brace to gusset weld

Step 1: Check the brace net section rupture capacity

Per AISC 341-10 the connection must develop the expected tensile yield strength of the brace
 Per the general notes, wide flange sections are either ASTM A36 and/or ASTM A572 Gr. 50. The expected material strength of each is close after multiplying by R_y per table A3.1

$$f_y := 36 \text{ ksi}$$

$$R_y := 1.5$$

$$f_u := 58 \text{ ksi}$$

$$A_{W10x60} := 17.7 \text{ in}^2$$

$$t_f := 0.68 \text{ in}$$

$$t_w := 0.42 \text{ in}$$

$$b_f := 10.1 \text{ in}$$

$$d := 10.2 \text{ in}$$

$$l_{weld} := 14 \text{ in}$$

$$f_{ye} := f_y \cdot R_y = 54 \text{ ksi}$$

$$T_u := f_{ye} \cdot A_{W10x60} = 955.8 \text{ kip}$$

Original drawings say to slot flange of brace. Based on site visit observations, top and bottom flange are coped to the web on one side of the brace. Take this as the net section area for tensile rupture

$$A_n := A_{W10x60} - 2 \cdot t_f \cdot \frac{(b_f - t_w)}{2} = 11.12 \text{ in}^2$$

$$2 d < l_{weld} = 0$$

$$2 d > l_{weld} > 1.5 \cdot d = 0$$

$$U := 0.75 \quad \text{Table D3.1 AISC 360-10}$$

$$A_e := A_n \cdot U = 8.34 \text{ in}^2$$

$$T_n := f_u \cdot A_e = 483.62 \text{ kip}$$

Existing building so use a phi of 1

$$\phi := 1$$

$$DCR := \frac{T_u}{\phi \cdot T_n} = 1.98$$

Step 2: Check brace to gusset weld

$$l_{weld} = 14 \text{ in}$$

$$t_{weld} := 0.5 \text{ in}$$

$$F_{EXX} := 70 \text{ ksi}$$

$$T_u = 955.8 \text{ kip}$$

$$\phi = 1$$

Eq 8-1

$$R_n := 2 \cdot 0.6 \cdot F_{EXX} \cdot \frac{\sqrt{2}}{2} t_{weld} \cdot l_{weld} = 415.78 \text{ kip}$$

$$DCR_{weld} := \frac{T_u}{\phi \cdot R_n} = 2.3$$



Purpose: To check if the W18x33 beam can resist the effect of the combine tensile and compressive brace capacities applied at midspan

Procedure: The calculation steps are as follows

Step 1: Determine brace capacities

Step 2: Check beam in chevron configuration

Step 1: Determine brace capacities

Per AISC 341-10 the connection must develop the expected tensile yield strength of the brace
 Per the general notes, wide flange sections are either ASTM A36 and/or ASTM A572 Gr. 50. The expected material strength of each is close after multiplying by R_y per table A3.1

$$f_y := 36 \text{ ksi}$$

$$A_{W10x60} := 17.7 \text{ in}^2$$

$$R_y := 1.5$$

$$f_u := 58 \text{ ksi}$$

$$E := 29000 \text{ ksi}$$

Tension

$$f_{ye} := f_y \cdot R_y = 54 \text{ ksi}$$

$$T_u := f_{ye} \cdot A_{W10x60} = 955.8 \text{ kip}$$

Compression

No slender elements from quick check worksheet. Kl/r calculated in quick check worksheet

$$Klr := 110.12$$

$$F_e := \frac{\pi^2 \cdot E}{Klr^2} = 23.6 \text{ ksi}$$

$$\frac{f_y}{F_e} = 1.53 \qquad \frac{f_y}{F_e} \leq 2.25 = 1$$

$$F_{cr} := \left(0.658 \frac{f_y}{F_e}\right) \cdot f_y = 19.01 \text{ ksi}$$

$$P_n := A_{W10x60} \cdot F_{cr} = 336.53 \text{ kip}$$

$$C_u := 0.3 \cdot P_n = 100.96 \text{ kip}$$

AISC 341-10 F1.4a



Step 2: Check beam in chevron configuration

$$l_{beam} := 20 \text{ ft}$$

$$\theta := \arccos\left(\frac{10 \text{ ft}}{16 \text{ ft}}\right) = 51.32 \text{ deg}$$

$$P := \sin(\theta) \cdot (T_u - C_u) = 667.31 \text{ kip}$$

$$M_u := \frac{P \cdot l_{beam}}{4} = 40038.56 \text{ kip} \cdot \text{in}$$

Pin Pin per connection assumed based on details

$$Z_{x_W18x35} := 66.5 \text{ in}^3$$

$$M_n := f_{ye} \cdot Z_{x_W18x35} = 3591 \text{ kip} \cdot \text{in}$$

$$\phi := 1$$

$$DCR := \frac{M_u}{\phi \cdot M_n} = 11.15$$



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920.0 - Social Science 1

Appendix C
Pictures and Details



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920.0 - Social Science 1



4th floor - Brace not framing into column



Coped flange at brace gusset



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920.0 - Social Science 1




Foundation crawl space



Lower Ground Floor - Coped flange at brace gusset




University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920.0 - Social Science 1



North 2nd floor plan - typ




University of California, Santa Cruz
 ASCE 41-17 Tier 1 Seismic Evaluation
 7920.0 - Social Science 1

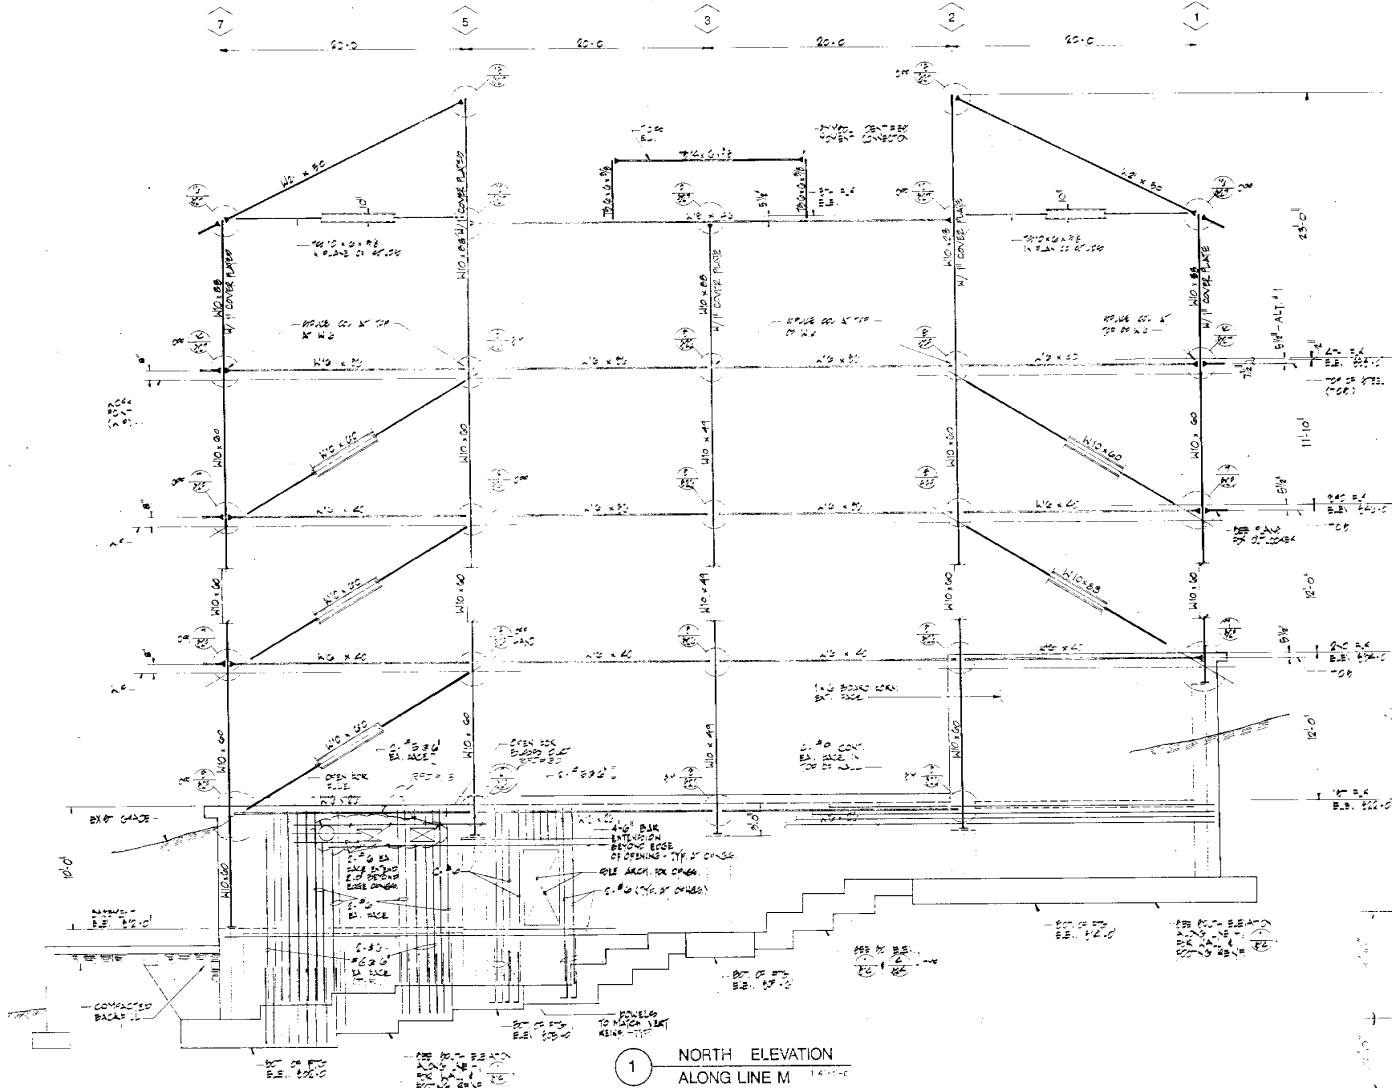

Typical brace frame section - transverse direction





University of California, Santa Cruz
 ASCE 41-17 Tier 1 Seismic Evaluation
 7920.0 - Social Science 1

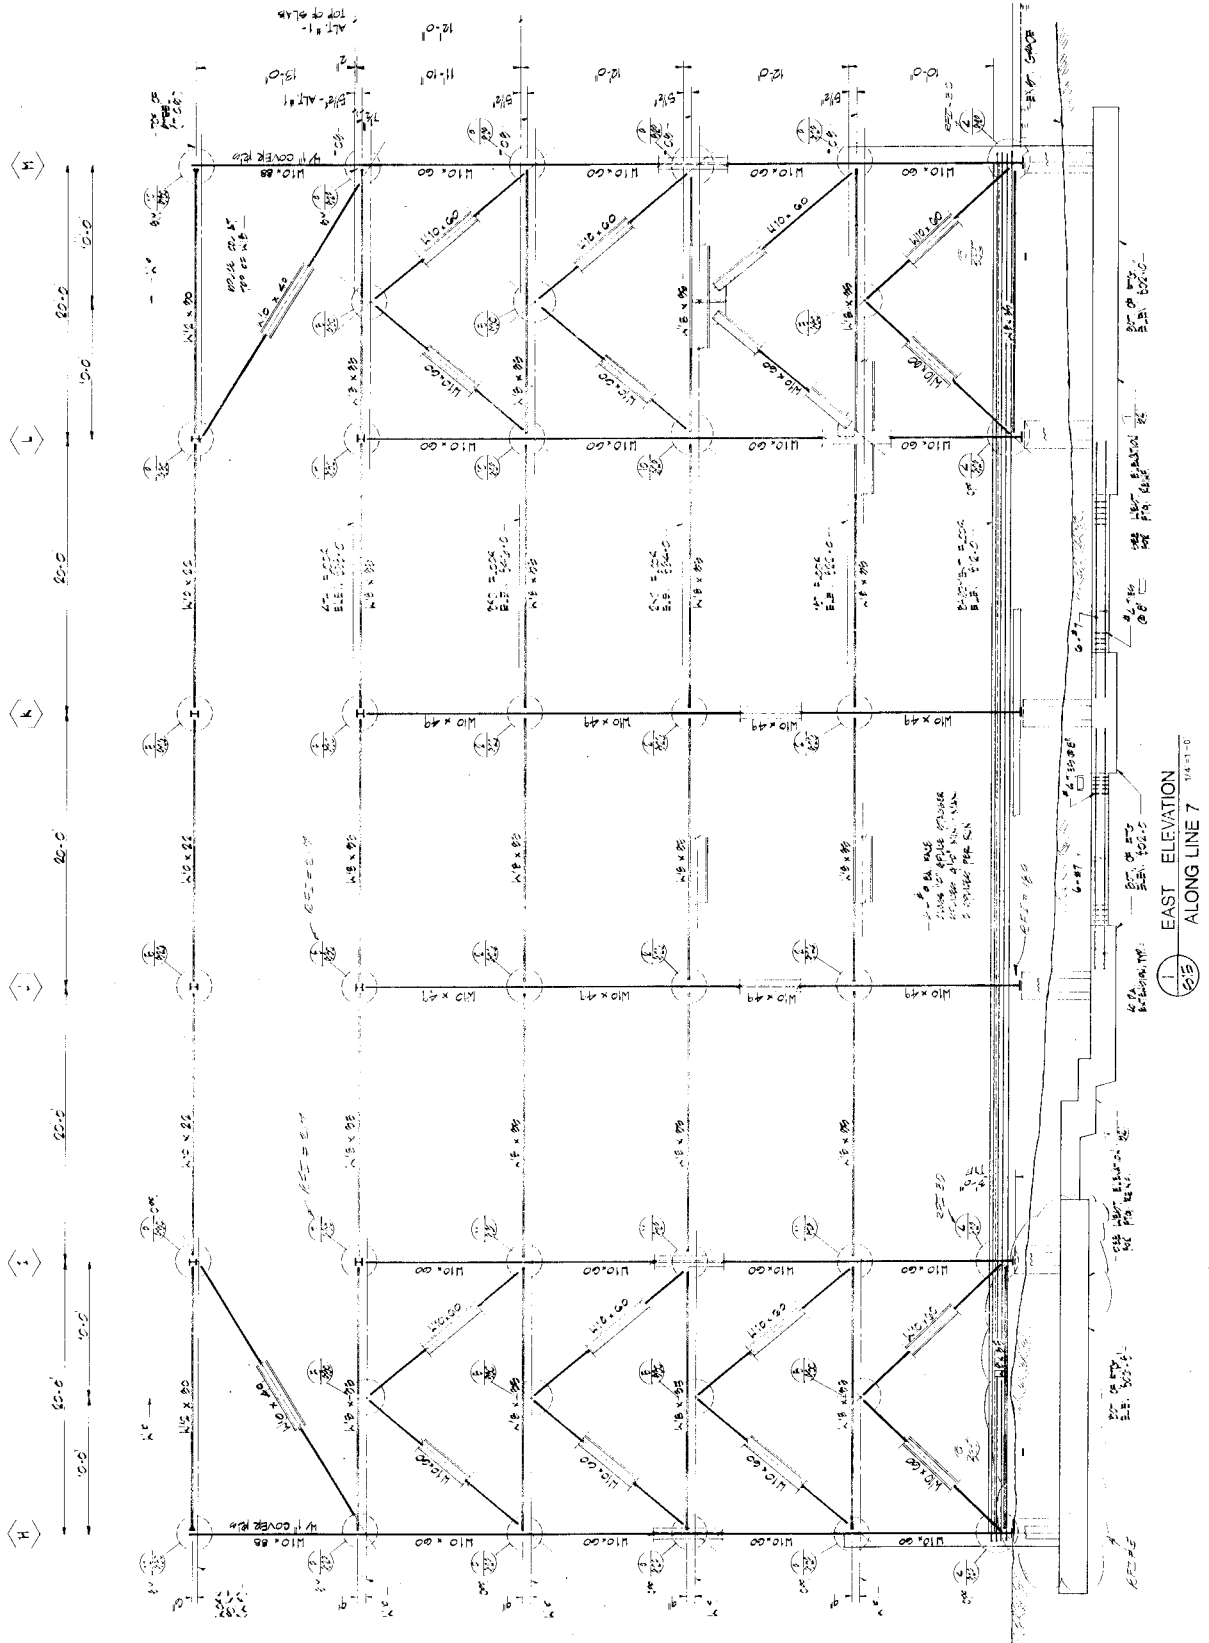

Typical brace frame section - longitudinal direction



University of California, Santa Cruz
ASCE 41-17 Tier 1 Seismic Evaluation
7920.0 - Social Science 1

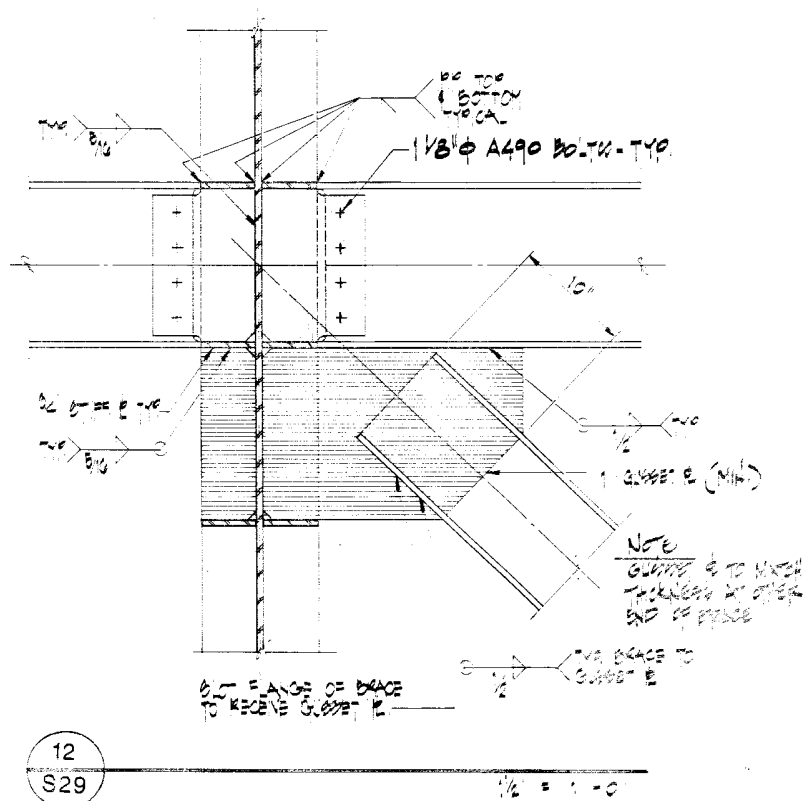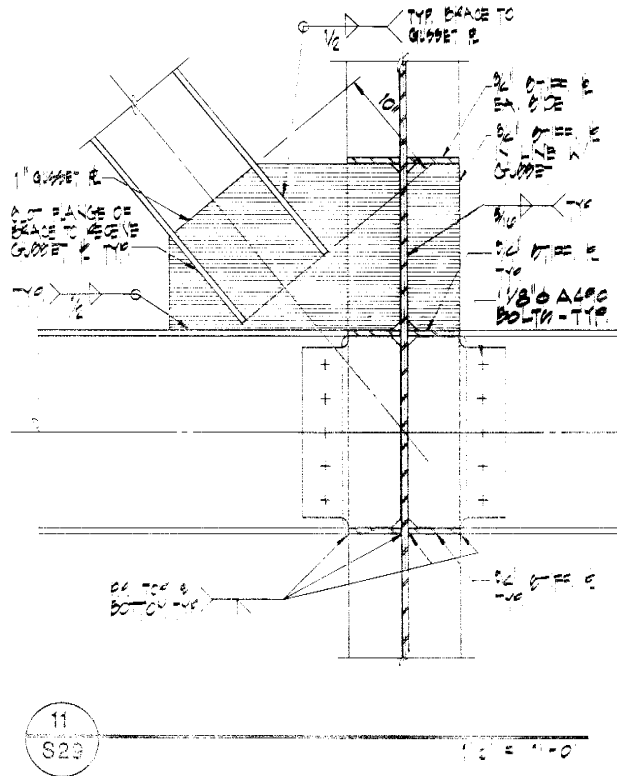

Typical brace connection details